


Data sheet

Differential pressure controller (PN 16)

AVP - return and flow mounting, adjustable setting
AVP-F - return mounting, fixed setting

Description

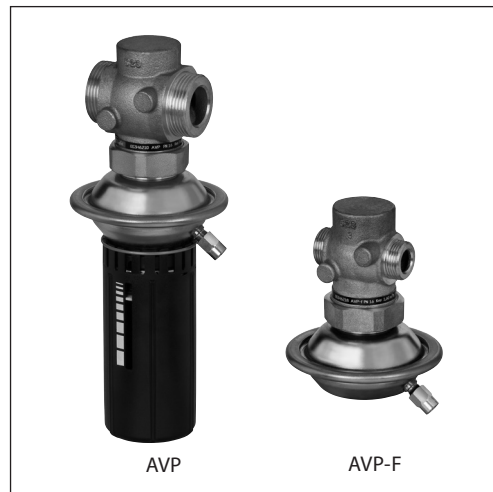

The controller has a control valve, an actuator with one control diaphragm and handle for differential pressure setting (fixed setting version is without handle).

Main data:

- DN 15-32
- k_{vs} 0.4-10 m³/h
- PN 16
- Setting range (AVP): 0.05-0.5 bar / 0.2-1.0 bar / 0.8-1.6 bar
- Fixed setting (AVP-F): 0.2 bar / 0.3 bar / 0.5 bar
- Temperature:
 - Circulation water / glycolic water up to 30%: 2 ... 150 °C
- Connections:
 - Ext. thread (weld-on, thread and flange tailpieces)

AVP(-F) is a self-acting differential pressure controller primarily for use in district heating systems. The controller closes on rising differential pressure.

Ordering

AVP Controller (return mounting)

Picture	DN (mm)	k_{vs} (m ³ /h)	Connection	Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.
	15	1.6	Cylindr. ext. thread acc. to ISO 228/1	G ¾ A	0.05-0.5	0.2-1.0	0.05-0.5	0.8-1.6	003H6212
		2.5					003H6206		
		4.0					003H6207		
		6.3					003H6208		
		8.0					003H6209		
		10					003H6210		
	20	6.3	G 1 A	0.05-0.5	0.2-1.0	0.8-1.6	003H6203	003H6215	
	25	8.0	G 1¼ A				003H6204	003H6216	
	32	10	G 1¾ A				003H6205	003H6211	
							003H6217		

Example 1:

Differential pressure controller; return mounting; DN 15; k_{vs} 1.6; PN 16; setting range 0.2-1.0 bar; T_{max} 150 °C; ext. thread;

- 1x AVP DN 15 controller
Code No: **003H6206**
- 1x Impulse tube set AV, R ½
Code No: **003H6852**

Option:

- 1x Weld-on tailpieces
Code No: **003H6908**

The controller will be delivered completely assembled, inclusive impulse tube between valve and actuator. External impulse tube (AV) must be ordered separately.

AVP Controller (flow mounting)

Picture	DN (mm)	k_{vs} (m ³ /h)	Connection	Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.
	15	0.4	Cylindr. ext. thread acc. to ISO 228/1	G ¾ A	0.05-0.5	0.2-1.0	003H6947 ¹⁾
		1.0					003H6948 ¹⁾
		1.6					003H6238
		2.5					003H6239
		4.0					003H6240
		6.3					003H6241
	20	6.3	G 1 A	0.05-0.5	0.2-1.0	003H6246	
	25	8.0	G 1¼ A			003H6247	
	32	10	G 1¾ A			003H6242	003H6248
						003H6243	003H6249

¹⁾ This version of controller can be mounted in return or in flow pipe. When ordering 2 impulse tube sets AV (instead of 1) should be ordered (see ordering example 2).

Ordering (continuous)

AVP-F Controller (return mounting)

Picture	DN (mm)	k _{vs} (m ³ /h)	Connection	Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.	Δp setting range (bar)	Code No.	
	15	1.6	Cylindr. ext. thread acc. to ISO 228/1	0.2	003H6218	0.3	003H6224	0.5	003H6230	
		2.5			003H6219		003H6225		003H6231	
		4.0			003H6220		003H6226		003H6232	
	20	6.3			G 1 A		003H6221		003H6227	003H6233
	25	8.0			G 1¼ A		003H6222		003H6228	003H6234
	32	10			G 1¾ A		003H6223		003H6229	003H6235

Example 2:
Differential pressure controller; flow mounting; DN 15; k_{vs} 0.4; PN 16; setting range 0.2-1.0 bar; T_{max} 150 °C; ext. thread;

- 1x AVP DN 15 controller
Code No: **003H6947**
- 2x Impulse tube set AV, R ½
Code No: **003H6852**

Option:
- 1x Weld-on tailpieces
Code No: **003H6908**

The controller will be delivered completely assembled, inclusive impulse tube between valve and actuator. External impulse tube (AV) must be ordered separately.

Accessories

Picture	Type designation	DN	Connection	Code No.
	Weld-on tailpieces	15	-	003H6908
		20		003H6909
		25		003H6910
		32		003H6911
	External thread tailpieces	15	Conical ext. thread acc. to EN 10226-1	R ½ 003H6902
		20		R ¾ 003H6903
		25		R 1 003H6904
		32		R 1¼ 003H6905
	Flange tailpieces	15	Flanges PN 25, acc. to EN 1092-2	003H6915
		20		003H6916
		25		003H6917
	Impulse tube set AV	Description: - 1x copper tube Ø 6 × 1 × 1500 mm - 1x compression fitting ¹⁾ for imp. tube connection to pipe Ø 6 × 1 mm		R ½ 003H6852
				R ¾ 003H6853
				R 1 003H6854
	¹⁾ 10 compression fittings for imp. tube connection to pipe, Ø 6 × 1 mm	R ½		003H6857
		R ¾		003H6858
		R 1		003H6859
		R 1¼		003H6931
	Shut off valve Ø 6 mm			003H0276

¹⁾ Compression fitting consists of a nipple, compression ring and nut.

Service kits

Picture	Type designation	DN	k _{vs} (m ³ /h)	Code No.	
				AVP(-F) return	AVP(-F) flow
	Valve insert	15	0.4	-	003H6869
			1.0	-	003H6870
			1.6	003H6863	003H6871
			2.5	003H6864	003H6872
		20	6.3	003H6865	003H6873
		25	8.0	003H6866	003H6874
		32	10	003H6867	003H6875
	Actuator with adjustable handle (AVP)		0.05-0.5	003H6821	003H6823
			0.2-1.0	003H6822	003H6824
			0.8-1.6		
	Actuator without adjustable handle (AVP-F)		0.2	003H6825	-
			0.3		
			0.5		

Technical data


Valve

Nominal diameter		DN	15					20	25	32
k _{vs} value		m ³ /h	0.4	1.0	1.6	2.5	4.0	6.3	8.0	10
Cavitation factor z			≥ 0.6					≥ 0.55		
Leakage acc. to standard IEC 534		% of k _{vs}	≤ 0.02					≤ 0.05		
Nominal pressure		PN	25							
Max. differential pressure		bar	12							
Medium			Circulation water / glycolic water up to 30%							
Medium pH			Min. 7, Max. 10							
Medium temperature		°C	2...150							
Connections	valve		External thread							
	tailpieces		Weld-on and external thread							
				Flange						
Materials										
Valve body			Red bronze CuSn5ZnPb (Rg5)							
Valve seat			Stainless steel, mat. No. 1.4571							
Valve cone			Dezincing free brass CuZn36Pb2As							
Sealing			EPDM							
Pressure relieve system			Piston							

Actuator


Type		AVP			AVP-F			
Actuator size		cm ²	39					
Nominal pressure		PN	16					
Diff. pressure setting ranges and spring colours	bar	0.05-0.5	0.2-1.0	0.8-1.6	0.2	0.3	0.5	
		grey	black		(fixed setting)			
Materials								
Actuator housing		Zinc plated, DIN 1624, No. 1.0338						
Diaphragm		EPDM						
Impulse tube		Copper tube Ø 6 x 1 mm						

Application principles
- Return mounting

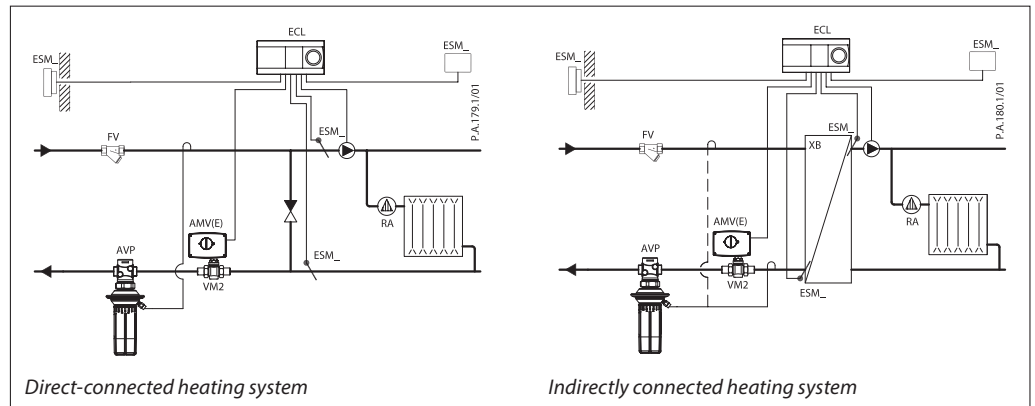

Application principles



- Flow mounting

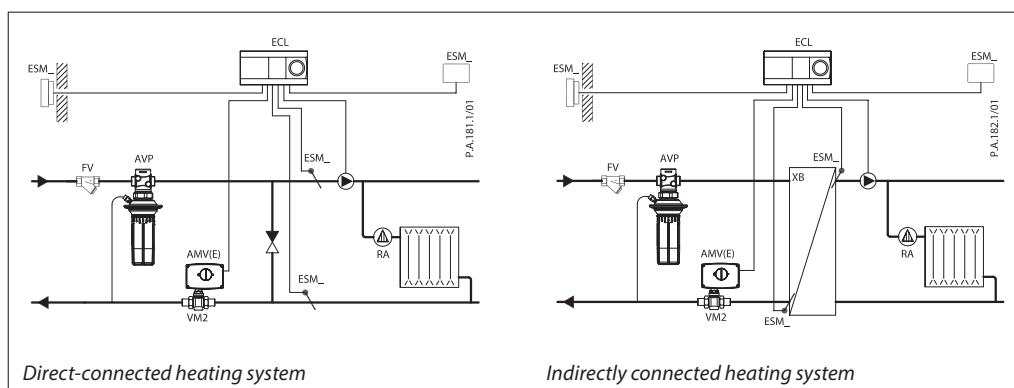


Installation positions

Up to medium temperature of 100 °C the controllers can be installed in any position.

For higher temperatures the controllers have to be installed in horizontal pipes only, with a pressure actuator oriented downwards.

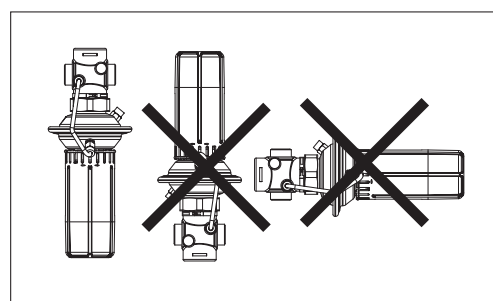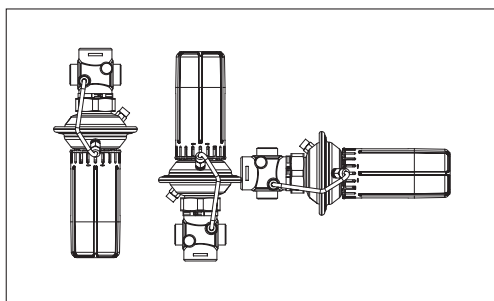

Pressure temperature diagram

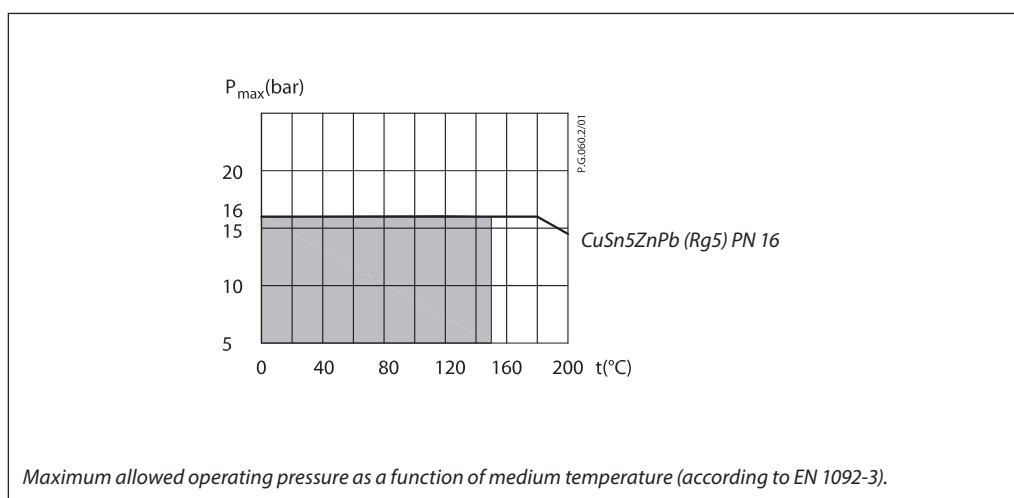

Maximum allowed operating pressure as a function of medium temperature (according to EN 1092-3).

Sizing

- Directly connected heating system

Example 1

Motorised control valve (MCV) for mixing circuit in direct-connected heating system requires differential pressure of 0.2 bar (20 kPa).

Given data:

- Q_{max} = 1.3 m³/h (1300 l/h)
- Δp_{min} = 0.7 bar (70 kPa)
- * $\Delta p_{circuit}$ = 0.1 bar (10 kPa)
- Δp_{MCV} = 0.2 bar (20 kPa) selected

*Remark

$\Delta p_{circuit}$ corresponds to the required pump pressure in the heating circuit and is not to be considered when sizing the AVP

The differential pressure set value is:

$$\Delta p_{set\ value} = \Delta p_{MCV}$$

$$\Delta p_{set\ value} = 0.2\ bar\ (20\ kPa)$$

The total pressure loss across the controller is:

$$\Delta p_{AVP} = \Delta p_{min} - \Delta p_{MCV} = 0.7 - 0.2$$

$$\Delta p_{AVP} = 0.5\ bar\ (50\ kPa)$$

Possible pipe pressure losses in tubes, shut-off fittings, heatmeters, etc. are not included.

k_v value is calculated according to formula:

$$k_v = \frac{Q_{max}}{\sqrt{\Delta p_{AVP}}} = \frac{1.3}{\sqrt{0.5}}$$



$$k_v = 1.8\ m^3/h$$

or read from the sizing diagram, page 7, by taking a line from Q-scale (1.3 m³/h) through Δp_v -scale (0.5 bar) to intersect k_v -scale at 1.8 m³/h.

Solution:

The example selects AVP DN 15, k_{vs} value 2.5, with differential pressure setting range 0.05-0.5 bar.

The P-band (X_p) can also be read from the sizing diagram. Take a horizontal line from the k_v -scale (1.8 m³/h) to the right to intersect the X_p -scale (0.04 bar). At a set value of 0.2 bar and a X_p of 0.04 bar the AVP controller controls between 0.2 bar with open motorised control valve and $0.2 + 0.04 = 0.24$ bar at almost closed motorised control valve (i.e. total pressure loss across the motorised control valve).

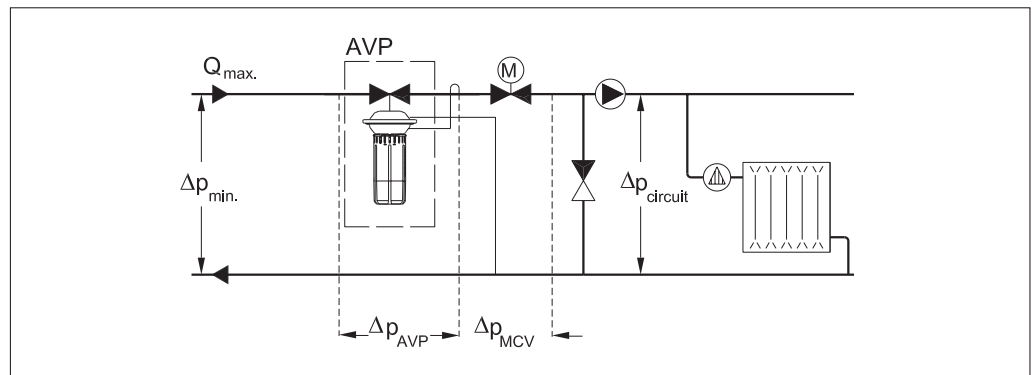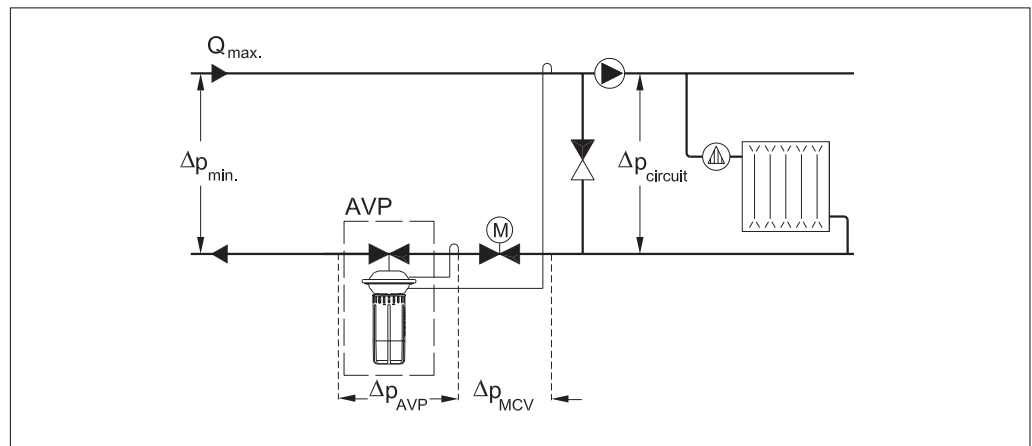

Sizing (continuous)

- Indirectly connected heating system

Example 2

Motorised control valve (MCV) for indirectly connected heating system requires differential pressure of 0.3 (30 kPa) bar.

Given data:

- Q_{max} = 0.8 m³/h (800 l/h)
- Δp_{min} = 0.8 bar (80 kPa)
- $\Delta p_{exchanger}$ = 0.05 bar (5 kPa)
- Δp_{MCV} = 0.3 bar (30 kPa) selected

The differential pressure set value is:

$$\Delta p_{set\ value} = \Delta p_{exchanger} + \Delta p_{MCV} = 0.05 + 0.3$$

$$\Delta p_{set\ value} = 0.35\ \text{bar (35 kPa)}$$

The total pressure loss across the controller is:

$$\Delta p_{AVP} = \Delta p_{min} - \Delta p_{exchanger} - \Delta p_{MCV}$$

$$= 0.8 - 0.05 - 0.3$$

$$\Delta p_{AVP} = 0.45\ \text{bar (45 kPa)}$$

Possible pipe pressure losses in tubes, shut-off fittings, heatmeters, etc. are not included.

k_v value is calculated according to formula:

$$k_v = \frac{Q_{max}}{\sqrt{\Delta p_{AVP}}} = \frac{0.8}{\sqrt{0.45}}$$



$$k_v = 1.2\ \text{m}^3/\text{h}$$

or read from the sizing diagram, page 7, by taking a line from Q-scale (0.8 m³/h) through Δp_v -scale (0.45 bar) to intersect k_v -scale at 1.2 m³/h.


Solution:

The example selects AVP DN 15, k_{vS} value 1.6, with differential pressure setting range 0.05-0.5 bar.

The P-band (X_p) can also be read from the sizing diagram. Take a horizontal line from the k_v -scale (1.2 m³/h) to the right to intersect the X_p -scale (0.04 bar). At a set value of 0.35 bar and a X_p of 0.04 bar the AVP controller controls between 0.35 bar with open motorised control valve and $0.35 + 0.04 = 0.39$ bar at almost closed motorised control valve (i.e. total pressure loss across the motorised control valve).

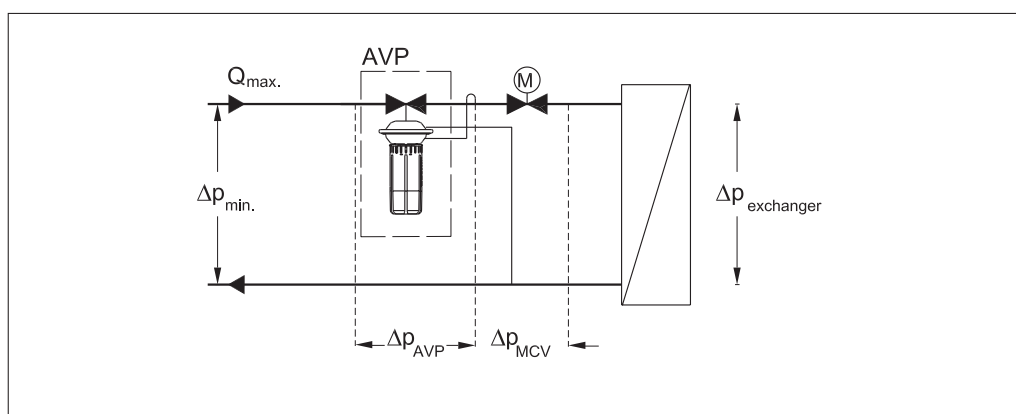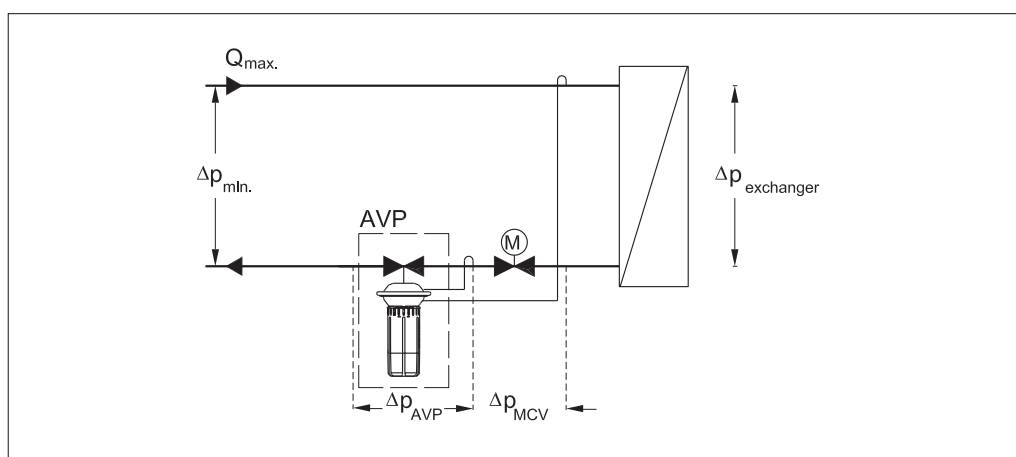


Sizing (continuous)

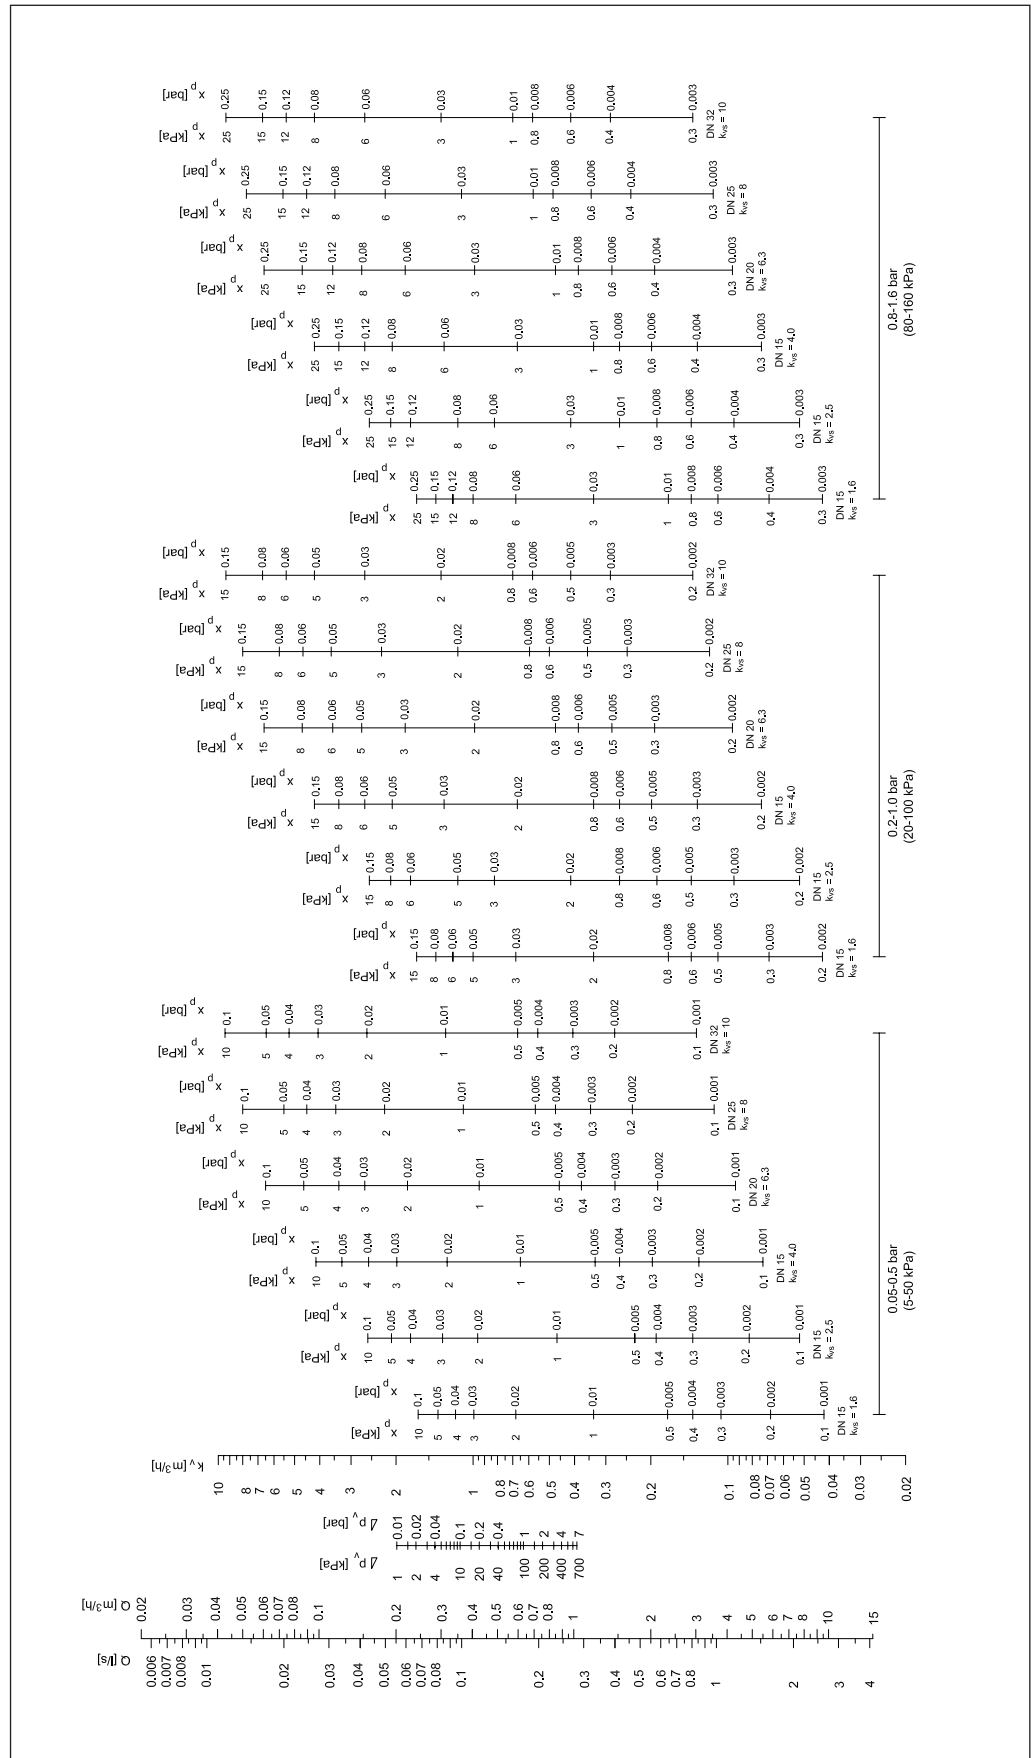

Select suitable controller size. Xp should not exceed 50% of the controller differential pressure setting.

Design

1. Valve body
2. Valve insert
3. Pressure relieved valve cone
4. Valve stem
5. Control drain
6. Actuator
7. Control diaphragm for diff. pressure control
8. Setting spring for diff. pressure control
9. Handle for diff. pressure setting, prepared for sealing
10. Union nut
11. Compression fitting for impulse tube
12. Excess pressure safety valve

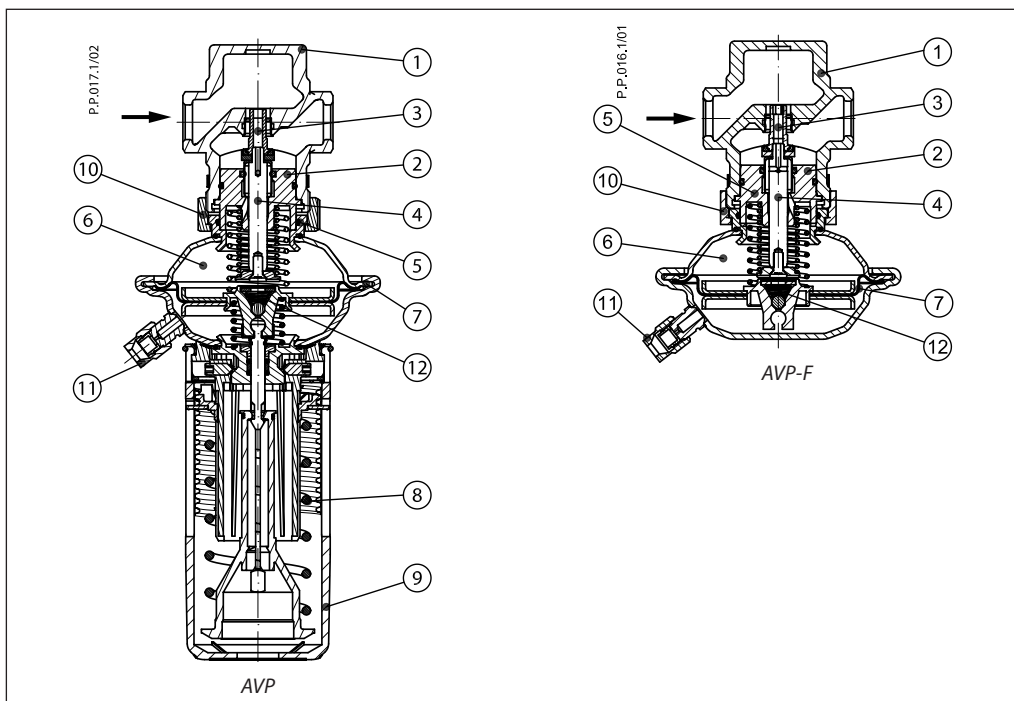

Function

Pressure changes from flow and return pipes are being transferred through the impulse tubes and/or control drain in the actuator stem to the actuator chambers and act on control diaphragm for diff. pressure control. The diff. pressure is controlled by means of setting spring for diff. pressure control. Control valve closes on rising differential pressure and opens on falling differential pressure to maintain constant differential pressure.


Controller is equipped with excess pressure safety valve, which protects control diaphragm for diff. pressure control from too high differential pressure.

Settings


Differential pressure setting
 Differential pressure setting (valid for AVP controller only) is being done by the adjustment of the setting spring for diff. pressure control. The adjustment can be done by means of handle for diff. pressure setting and/or pressure indicators.

Adjustment diagram

Relation between scale figures and differential pressure. Values given are approximate.

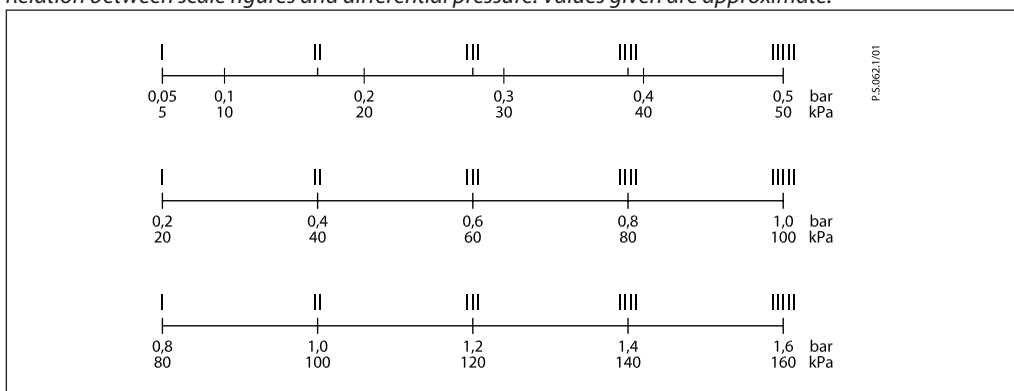

Dimensions

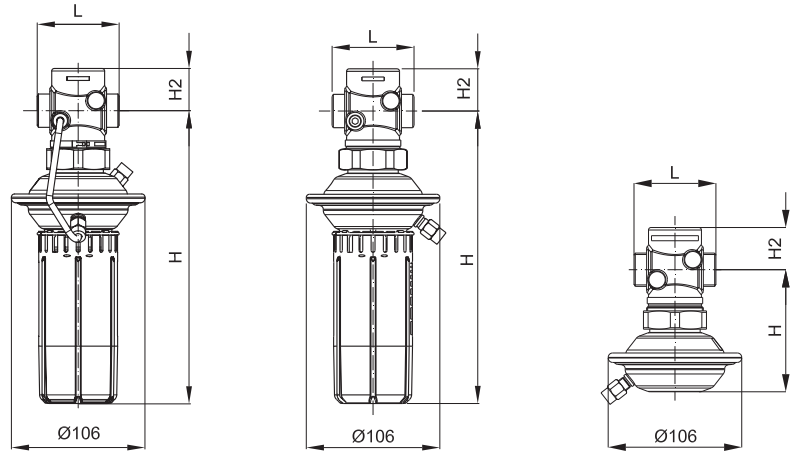


AVP (flow, return)

DN	L	H	H2	Weight (kg)
	mm			
15	65	232	34	1.7
20	70	232	34	1.8
25	75	232	38	1.9
32	100	232	38	2.2

AVP-F (return)

DN	L	H	H2	Weight (kg)
	mm			
15	65	97	34	1.3
20	70	97	34	1.4
25	75	97	38	1.5
32	100	97	38	1.8

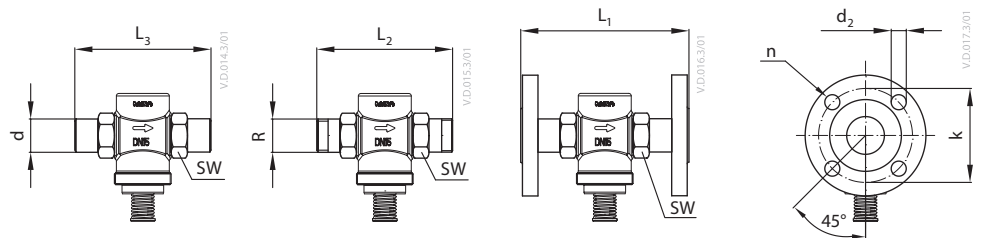

DN	R ¹⁾	SW	d	L ₁ ²⁾	L ₂	L ₃	k	d ₂	n
				mm					
15	½	32 (G ¾A)	21	130	120	139	65	14	4
20	¾	41 (G 1A)	26	150	131	154	75	14	4
25	1	50 (G 1¼A)	33	160	145	159	85	14	4
32	1¼	63 (G 1¾A)	42	-	177	184	-	-	-

¹⁾ Conical ext. thread acc. to EN 10226-1

²⁾ Flanges PN 25, acc. to EN 1092-2

Compression fittings

